

HYBRID CONTROL OF PV FED CHB MULTILEVEL INVERTER WITH MAXIMUM POWER POINT TRACKING FOR POWER QUALITY IMPROVEMENT

¹Kandukuri Swathi, ²Satyanarayana Vanam, ³Ramkumar Adepu
^{1,2,3} EEE Dept, Vaagdevi Engineering College, Warangal

Abstract: This paper presents hybrid control of PV fed CHB multilevel inverter with maximum power point tracking for power quality improvement. Cascaded multilevel topology helps in decrease of harmonic distortion which recovers the efficiency and elasticity of PV systems. To distinguish superior exploitation of PV modules and maximize the solar energy extraction, a distributed MPPT control scheme is developed to three-phase multilevel inverters, which permits self-governing control of each dc-link voltage. Due to diverse irradiance conditions, PV mismatches may announce unstable supplied power, lead into instable grid current. In order to overcome this drawback a control scheme with modulation Compensation is also proposed. This modulation compensation is constructed with PI plus Fuzzy logic controller to reduce total harmonic distortion (THD) which recovers efficiency. The proposed concept is designed and implemented with MATLAB/Simulation software. Simulation results are obtainable to authenticate the viability of the proposed approach.

Keywords- Cascaded multilevel inverter, Maximum power point tracking (MPPT), PI controller, Fuzzy logic controller, Modulation compensation, Photovoltaic (PV).

I. Introduction

Due to the shortage of fossil fuel, Solar-electric-energy demand has grown consistently by 20%–25% per annum over the past 20 years [1], and the growth is mostly in grid-connected applications. With the extraordinary market growth in grid-connected photovoltaic (PV) systems, there are increasing interests in grid-connected PV configurations. Five inverter families can be defined, which are related to different configurations of the PV system: 1) central inverters; 2) string inverters; 3) multistring inverters; 4) ac-module inverters; and 5) cascaded inverters [2]–[7]. The configurations of PV systems are shown in Fig. 1. Cascaded inverters consist of several converters connected in series; thus, the high power and/or high voltage from the combination of the multiple modules would favor this topology in medium and large grid-connected PV systems [8]–[10]. There are two types of cascaded inverters. Fig. 1(e) shows a cascaded dc/dc converter connection of PV modules [11], [12]. Each PV module has its own dc/dc converter, and the modules with their associated converters are still connected in series to create a high dc voltage, which is provided to a simplified dc/ac inverter. This approach combines aspects of string inverters and ac-module inverters. However there are two power conversion stages in this configuration. Another cascaded inverter is shown in Fig. 1(f), where each PV panel is connected to its own dc/ac inverter, and those inverters are then placed in series to reach a high-voltage level [13]–[16].

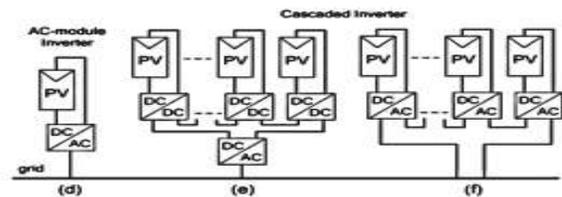
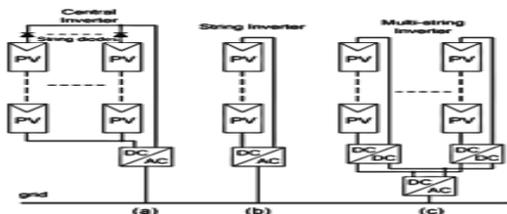


Fig.1. Configurations of PV systems (a) Central inverter (b) String inverter(c) Multistring inverter (d) AC-module inverter (e) Cascaded dc/dc converter(f) Cascaded dc/ac inverter

A three-phase modular cascaded multilevel inverter prototype has been built. Each H-bridge is connected to a 185-W solar panel. The modular design will increase the flexibility of the system and reduce the cost as well. Simulation and experimental results are provided to demonstrate the developed control scheme.

Maximum Power Point Tracking (MPPT)

Maximum Power Point Tracking, frequently referred to as MPPT, is an electronic system that operates the Photovoltaic (PV) modules in a manner that allows the modules to produce all the power they are capable of. MPPT is not a mechanical tracking system that “physically moves” the modules to make them point more directly at the sun. MPPT is a fully electronic system that varies the electrical operating point of the modules so that the modules are able to deliver maximum available power. Additional power harvested from the modules is then made available as increased battery charge current. MPPT can be used in conjunction with a mechanical tracking system, but the two systems are completely different. The problem considered by MPPT methods is to automatically find the voltage VMPP or current IMPP at which a PV array delivers maximum power under a given temperature and

irradiance. In this section, commonly used MPPT methods are introduced in an arbitrary order.

II. System Description

Modular cascaded H-bridge multilevel inverters for single and three-phase grid-connected PV systems are shown in Fig. 2. Each phase consists of n H-bridge converters connected in series, and the dc link of each H-bridge can be fed by a PV panel or a short string of PV panels. The cascaded multilevel inverter is connected to the grid through L filters, which are used to reduce the switching harmonics in the current. By different combinations of the four switches in each H-bridge module, three output voltage levels can be generated: $-v_{dc}$, 0 , or $+v_{dc}$. A cascaded multilevel inverter with n input sources will provide $2n + 1$ levels to synthesize the ac output waveform. This $(2n + 1)$ -level voltage waveform enables the reduction of harmonics in the synthesized current, reducing the size of the needed output filters. Multilevel inverters also have other advantages such as reduced voltage stresses on the semiconductor switches and having higher efficiency when compared to other converter topologies [17].

III. Divergences Of Pv Panel

PV mismatch is an important issue in the PV system. Due to the unequal received irradiance, different temperatures, and aging of the PV panels, the MPP of each PV module may be different. If each PV module is not controlled independently, the efficiency of the overall PV system will be decreased. To show the necessity of individual MPPT control, a five-level two-H-bridge single-phase inverter is simulated in MATLAB/SIMULINK. Each H-bridge has its own 185-W PV panel connected as an isolated dc source. The PV panel is modeled according to the specification of the commercial PV panel from A strong energy CHSM-5612M. Consider an operating condition that each panel has a different irradiation from the sun; panel 1 has irradiance $S = 1000 \text{ W/m}^2$, and panel 2 has $S = 600 \text{ W/m}^2$. When the S values are 1000 and 600 W/m^2 , respectively, which means that the total power harvested from the PV system would be 293.5 W if individual MPPT can be achieved. This higher value is about 1.45 times of the one before. For example, to unbalance the current per phase more than 10% is not allowed for some utilities, where the percentage imbalance is calculated by taking the maximum deviation from the average current and dividing it by the average current [18].

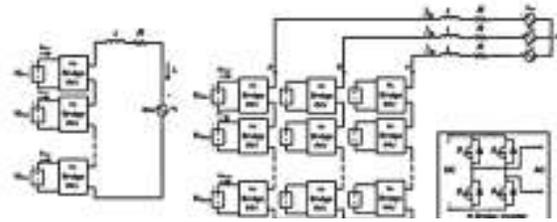


Fig.2. Topology of the modular cascaded H-bridge multilevel inverter for grid-connected PV

IV. Control Scheme

A. Distributed MPPT Control

In order to eliminate the adverse effect of the mismatches and increase the efficiency of the PV system, the PV modules need to operate at different voltages to improve the utilization per PV module. The separate dc links in the cascaded H-bridge multilevel inverter make independent voltage control possible. To realize individual MPPT control in each PV module, the control scheme proposed in [19] is updated for this application. The distributed MPPT control of the three-phase cascaded H-bridge inverter is shown in Fig. 5. In each H-bridge module, an MPPT controller is added to generate the dc-link voltage reference. Each dc-link voltage is compared to the corresponding voltage reference through proportional-integral (PI) controller and the sum of all errors is controlled through a total voltage controller (i.e.,) fuzzy logic controller that determines the current reference I_{dref} . The reactive current reference I_{qref} can be set to zero, or if reactive power compensation is required, I_{qref} can also be given by a reactive current calculator [20], [21]. The synchronous reference frame phase-locked loop (PLL) has been used to find the phase angle of the grid voltage [22]. As the classic control scheme in three-phase systems, the grid currents in ab coordinates are converted to dq coordinates and regulated through proportional-integral (PI) controllers to generate the modulation index in the dq coordinates, which is then converted back to three phases. The fuzzy logic controller gives the magnitude of the active current reference, and a PLL provides the frequency and phase angle of the active current reference. The current loop then gives the modulation index. To make each PV module operate at its own MPP, take phase a as an example; the voltages v_{dca2} to v_{dcn} are controlled individually through $n - 1$ loops. Each voltage controller gives the modulation index proportion of one H-bridge module in phase a . After multiplied by the modulation index of phase a , $n - 1$ modulation indices can be obtained. Also, the modulation index for the first H-bridge can be obtained by subtraction. The control schemes in phases b and c are almost the same. The only difference is that all dc-link voltages are regulated through PI

HYBRID CONTROL OF PV FED CHB MULTILEVEL INVERTER WITH MAXIMUM POWER POINT TRACKING FOR POWER QUALITY IMPROVEMENT

controllers, and n modulation index proportions are obtained for each phase. The total voltage controller used in this circuit fuzzy logic controller which helps in improvement in total harmonic distortion (THD). Design of a fuzzy controller requires more design decisions than usual, for example regarding rule base, inference engine, de-fuzzification, and data pre- and post process.

Table 1 Fuzzy Rules

E CE	HN	LN	ZE	LP	HP
HP	ZE	LP	HP	HP	HP
LP	LN	ZE	LP	HP	HP
ZE	HN	LN	ZE	LP	HP
LN	HN	HN	LN	ZE	LP
HN	HN	HN	HN	LN	ZE

Fig. 4 Fuzzy logic controllers.

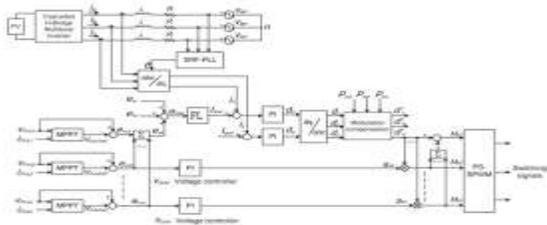


Fig.5. Control scheme for three-phase modular cascaded H-bridge multilevel PV inverter

A phase-shifted sinusoidal pulse width modulation switching scheme is then applied to control the switching devices of each H-bridge. It can be seen that there is one H-bridge module out of N modules whose modulation index is obtained by subtraction. For three-phase systems, $N = 3n$, where n is the number of H-bridge modules per phase. The reason is that N voltage loops are necessary to manage different voltage levels on N H-bridges, and one is the total voltage loop, which gives the current reference. So, only $N - 1$ modulation indices can be determined by the last $N - 1$ voltage loops, and one modulation index has to be obtained by subtraction. Many MPPT methods have been developed and implemented [23], [24]. The incremental conductance method has been used in this paper. It lends itself well to digital control, which can easily keep track of previous values of voltage and current and make all decisions.

B. Modulation Compensation

As mentioned earlier, a PV mismatch may cause more problems to a three-phase modular cascaded H-bridge multilevel PV inverter. With the individual MPPT control

in each H-bridge module, the input solar power of each phase would be different, which introduces unbalanced current to the grid. To solve the issue, a zero sequence voltage can be imposed upon the phase legs in order to affect the current flowing into each phase [25], [26]. If the updated inverter output phase voltage is proportional to the unbalanced power, the current will be balanced. Thus, the modulation compensation block, as shown in Fig. 6, is added to the control system of three-phase modular cascaded multilevel PV inverters.

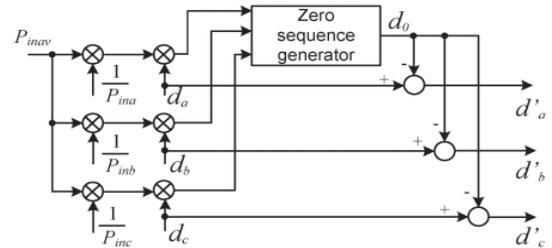


Fig.6. Modulation compensation scheme

First, the unbalanced power is weighted by ratio r_j , which is calculated as

$$r_j = \frac{P_{inav}}{P_{inj}} \quad (1)$$

Where P_{inj} is the input power of phase j ($j = a, b, c$), and P_{inav} is the average input power. Then, the injected zero sequence modulation indexes can be generated as

$$d_0 = \frac{1}{2} [\min(r_a \cdot d_a, r_b \cdot d_b, r_c \cdot d_c) + \max(r_a \cdot d_a, r_b \cdot d_b, r_c \cdot d_c)] \quad (2)$$

Where d_j is the modulation index of phase j ($j = a, b, c$) and is determined by the current loop controller. The modulation index of each phase is updated by

$$d'_j = d_j - d_0 \quad (3)$$

Assume that the input power of each phase is unequal

$$P_{ina} = 0.8 \quad P_{inb} = 1 \quad P_{inc} = 1 \quad (4)$$

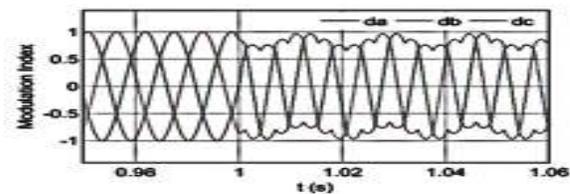



Fig. 7. Modulation indices before and after modulation compensation

By injecting a zero sequence modulation index at $t = 1$ s, the balanced modulation index will be updated, as shown in Fig. 7. It can be seen that, with the compensation, the updated modulation index is unbalanced proportional to the power, which means that the output voltage ($v_j N$) of the three-phase inverter is unbalanced, but this produces the desired balanced grid current.


HYBRID CONTROL OF PV FED CHB MULTILEVEL INVERTER WITH MAXIMUM POWER POINT TRACKING FOR POWER QUALITY IMPROVEMENT

Results& Discussions

To verify the proposed control scheme, the three-phase grid connected PV inverter is simulated in two different conditions. First, all PV panels are operated under the same irradiance $S = 1000 \text{ W/m}^2$ and temperature $T = 25 \text{ }^\circ\text{C}$. At $t = 0.8 \text{ s}$, the solar irradiance on the first and second panels of phase a decreases to 600 W/m^2 , and that for the other panels stays the same. The dc-link voltages of phase a are shown in Fig. 8. At the beginning, all PV panels are operated at an MPP voltage of 36.4 V . As the irradiance changes, the first and second dc link voltages decrease and track the new MPP voltage of 36 V , while the third panel is still operated at 36.4 V . The PV current waveforms of phase a are shown in Fig. 9. After $t = 0.8 \text{ s}$, the currents of the first and second PV panels are much smaller due to the low irradiance, and the lower ripple of the dc-link voltage can be found in Fig. 8(a) the dc-link voltages of phase b are shown in Fig. 10. All phase- b panels track the MPP voltage of 36.4 V , which shows that they are not influenced by other phases. The connected PV panel of each H-bridge can be operated at its own MPP voltage and will not be influenced by the panels connected to other H-bridges. Thus, more solar energy can be extracted, and the efficiency of the overall PV system will be increased. Fig. 11 shows the power extracted from each phase. At the beginning, all panels are operated under irradiance $S = 1000 \text{ W/m}^2$

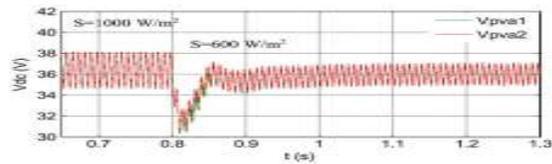

(a)

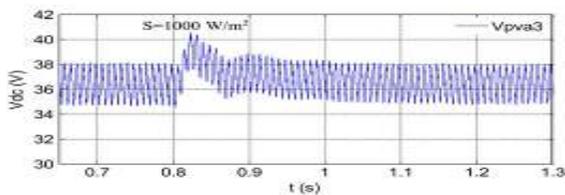

(b)

Fig. 8. DC-link voltages of phase a with distributed MPPT ($T = 25 \text{ }^\circ\text{C}$). (a) DC-link voltage of modules 1 and 2(b) DC-link voltage of module 3

Fig. 9. PV currents of phase a with distributed MPPT ($T = 25 \text{ }^\circ\text{C}$)

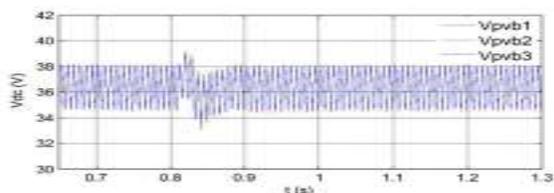


Fig. 10. DC-link voltages of phase b with distributed MPPT ($T = 25 \text{ }^\circ\text{C}$).

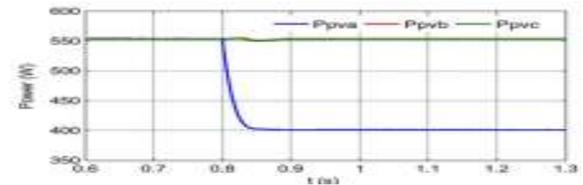


Fig. 11. Power extracted from PV panels with distributed MPPT

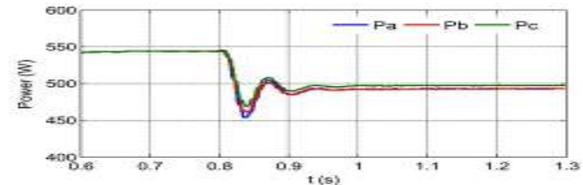


Fig. 12. Power injected to the grid with modulation compensation

And every phase is generating a maximum power of 555 W . After $t = 0.8 \text{ s}$, the power harvested from phase a decreases to 400 W , and those from the other two phases stay the same. Obviously, the power supplied to the three-phase grid-connected inverter is unbalanced. However, by applying the modulation compensation scheme, the power injected to the grid is still balanced, as shown in Fig. 12. In addition, by comparing the total power extracted from the PV panels with the total power injected to the grid, it can be seen that there is no extra power loss caused by the modulation compensation scheme. Fig. 13 shows the output voltages (v_{jN}) of the three-phase inverter. Due to the injected zero sequence component, they are unbalanced after $t = 0.8 \text{ s}$, which help to balance the grid current shown in Fig. 14

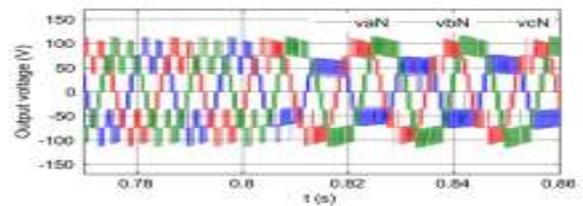


Fig. 13. Three-phase inverter output voltage waveforms with modulation compensation

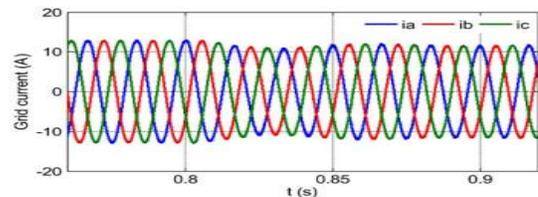


Fig. 14. Three-phase grid current waveforms with modulation compensation

HYBRID CONTROL OF PV FED CHB MULTILEVEL INVERTER WITH MAXIMUM POWER POINT TRACKING FOR POWER QUALITY IMPROVEMENT

The total harmonic distortion (THD) of grid current shown in below fig is 3.3% after fuzzy logic controller THD reduces to 2.5%, which is less than 5% and meets power quality standards, like IEEE 1547 in the U.S. and IEC 61727 in Europe.

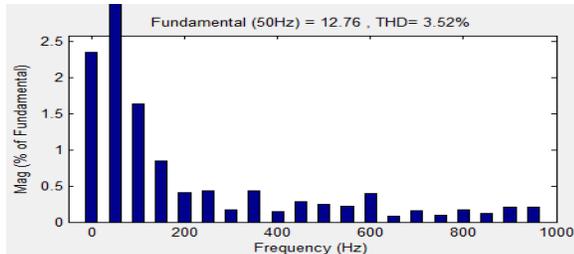


Fig. 15. Total harmonic distortion without fuzzy logic controller

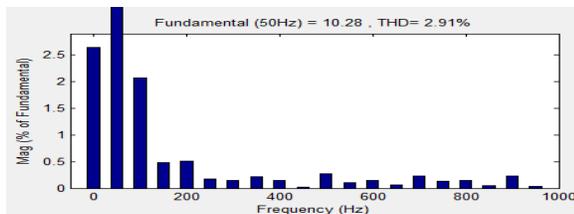


Fig. 16. Total harmonic distortion with Fuzzy logic controller

VI. CONCLUSION

This paper presents hybrid control of PV fed CHB multilevel inverter with maximum power point tracking for power quality improvement. The multilevel inverter topology will support to progress the utilization of connected PV modules if the voltages of the discrete dc links are controlled independently. Thus, a three-phase PV system has been applied to intensify the complete efficiency of PV systems. For the three-phase grid-connected PV system, PV mismatches may familiarize unstable supplied power, resulting in unbalanced injected grid current. A modulation compensation scheme, which will not escalate the complexity of the control system or cause extra power loss, is added to balance the grid current. With the proposed control scheme, each PV module can be operated at its own MPPT to maximize the solar energy extraction, and the three-phase grid current is balanced even with the unbalanced supplied solar power.

References

[1] J. M. Carrasco et al., "Power-electronic systems for the grid integration of renewable energy sources: A survey," *IEEE Trans. Ind. Electron.*, vol. 53, no. 4, pp. 1002–1016, Jun. 2006.

[2] S. B. Kjaer, J. K. Pedersen, and F. Blaabjerg, "A review of single-phase grid connected inverters for

photovoltaic modules," *IEEE Trans. Ind. Appl.*, vol. 41, no. 5, pp. 1292–1306, Sep./Oct. 2005.

[3] M. Meinhardt and G. Cramer, "Past, present and future of grid connected photovoltaic- and hybrid power-systems," in *Proc. IEEE PES Summer Meet.*, 2000, vol. 2, pp. 1283–1288.

[4] M. Calais, J. Myrzik, T. Spooner, and V. G. Agelidis, "Inverter for single-phase grid connected photovoltaic systems—An overview," in *Proc. IEEE PESC*, 2002, vol. 2, pp. 1995–2000.

[5] J. M. A. Myrzik and M. Calais, "String and module integrated inverters for single-phase grid connected photovoltaic systems—A review," in *Proc. IEEE Bologna Power Tech Conf.*, 2003, vol. 2, pp. 1–8.

[6] F. Schimpf and L. Norum, "Grid connected converters for photovoltaic, state of the art, ideas for improvement of transformer less inverters," in *Proc. NORPIE*, Espoo, Finland, Jun. 2008, pp. 1–6.

[7] B. Liu, S. Duan, and T. Cai, "Photovoltaic DC-building-module-based BIPV system—Concept and design considerations," *IEEE Trans. Power Electron.*, vol. 26, no. 5, pp. 1418–1429, May 2011.

[8] L. M. Tolbert and F. Z. Peng, "Multilevel converters as a utility interface for renewable energy systems," in *Proc. IEEE Power Eng. Soc. Summer Meet.*, Seattle, WA, USA, Jul. 2000, pp. 1271–1274.

[9] H. Ertl, J. Kolar, and F. Zach, "A novel multicell DC–AC converter for applications in renewable energy systems," *IEEE Trans. Ind. Electron.*, vol. 49, no. 5, pp. 1048–1057, Oct. 2002.

[10] S. Daher, J. Schmid, and F. L. M. Antunes, "Multilevel inverter topologies for stand-alone PV systems," *IEEE Trans. Ind. Electron.*, vol. 55, no. 7, pp. 2703–2712, Jul. 2008.

[11] G. R. Walker and P. C. Sernia, "Cascaded DC–DC converter connection of photovoltaic modules," *IEEE Trans. Power Electron.*, vol. 19, no. 4, pp. 1130–1139, Jul. 2004.

[12] E. Roman, R. Alonso, P. Ibanez, S. Elorduizapatarietxe, and D. Goitia, "Intelligent PV module for grid-connected PV systems," *IEEE Trans. Ind. Electron.*, vol. 53, no. 4, pp. 1066–1073, Jun. 2006.

[13] F. Filho, Y. Cao, and L. M. Tolbert, "11-level cascaded H-bridge grid tied inverter interface with solar panels," in *Proc. IEEE APEC Expo.*, Feb. 2010, pp. 968–972.

[14] C. D. Townsend, T. J. Summers, and R. E. Betz, "Control and modulation scheme for a cascaded H-bridge multi-level converter in large scale photovoltaic systems," in *Proc. IEEE ECCE*, Sep. 2012, pp. 3707–3714.

[15] B. Xiao, L. Hang, and L. M. Tolbert, "Control of three-phase cascaded voltage source inverter for grid-connected photovoltaic systems," in *Proc. IEEE APEC Expo.*, Mar. 2013, pp. 291–296.

[16] Y. Zhou, L. Liu, and H. Li, "A high-performance photovoltaic module integrated converter (MIC) based on cascaded quasi-Z-source inverters (qZSI) using eGaN FETs," *IEEE Trans. Power Electron.*, vol. 28, no. 6, pp. 2727–2738, Jun. 2013.

HYBRID CONTROL OF PV FED CHB MULTILEVEL INVERTER WITH MAXIMUM POWER POINT TRACKING FOR POWER QUALITY IMPROVEMENT

- [17] J. Rodriguez, J. S. Lai, and F. Z. Peng, "Multilevel inverters: A survey of topologies, controls, and applications," *IEEE Trans. Ind. Electron.*, vol. 49, no. 4, pp. 724–738, Aug. 2002.
- [18] Standard for Electric Installation and Use.[Online]. Available
- [19] A. Dell'Aquila, M. Liserre, V. Monopoli, and P. Rotondo, "Overview of PI-based solutions for the control of DC buses of a single-phase H-bridge multilevel active rectifier," *IEEE Trans. Ind. Appl.*, vol. 44, no. 3, pp. 857–866, May/Jun. 2008.
- [20] B. Xiao, K. Shen, J. Mei, F. Filho, and L. M. Tolbert, "Control of cascaded H-bridge multilevel inverter with individual MPPT for grid-connected photovoltaic generators," in *Proc. IEEE ECCE*, Sep. 2012, pp. 3715–3721.
- [21] Y. Xu, L. M. Tolbert, J. N. Chiasson, F. Z. Peng, and J. B. Campbell, "Generalized instantaneous non active power theory for STATCOM," *IET Elect. Power Appl.*, vol. 1, no. 6, pp. 853–861, Nov. 2007
- [22] V. Kaura and V. Blasko, "Operation of a phase locked loop system under distorted utility conditions," *IEEE Trans. Ind. Appl.*, vol. 33, no. 1, pp. 58–63, Jan./Feb. 1997.
- [23] T. Esmar and P. L. Chapman, "Comparison of photovoltaic array maximum power point tracking techniques," *IEEE Trans. Energy Convers.*, vol. 22, no. 2, pp. 439–449, Jun. 2007.
- [24] D. P. Hohm and M. E. Ropp, "Comparative study of maximum power point tracking algorithms," *Progr. Photovoltaic., Res. Appl.*, vol. 11, no. 1, pp. 47–62, Jan. 2003
- [25] S. Rivera et al., "Cascaded H-bridge multilevel converter multi string topology for large scale photovoltaic systems," in *Proc. IEEE ISIE*, Jun. 2011, pp. 1837–1844.
- [26] T. J. Summers, R. E. Betz, and G. Mirzaeva, "Phase leg voltage balancing of a cascaded H-bridge converter based STATCOM using zero sequence injection," in *Proc. Eur. Conf. Power Electron. Appl.*, Sep. 2009, pp. 1–10.
- [27] S. B. Kjaer, "Design and control of an inverter for photovoltaic applications," Ph.D. dissertation, Inst. Energy Technol., Aalborg University, Aalborg East, Denmark
- [28] V. RASHMI completed B.tech from JNTUH in the year 2013 and currently pursuing M.tech from G.Narayanamma institute of technology and science
- [29] G. UJWAL currently working as Assistant professor from the department of EEE, She has 7 years experience. She completed B.tech from JNTUH in 2008 and M.tech from JNTUH in the year 2010.